


PLAN VIEW

10 LF. OF 6" PERFORATED CORRUGATED P.V.C. UNDERDRAIN WITH GEOTEXTILE WRAP (TYP.) CONNECTED TO DRAINAGE STRUCTURE. BACKFILL WITH MDOT 34R OPEN GRADED AGGREGATE, PEA STONE (SEE DETAIL BELOW).




SECTION


TYPICAL 6" FINGER TYPE UNDERDRAIN DETAIL

(WITHIN PARKING LOTS OUTSIDE CURB LINES)

DETAIL - 5A
SCALE: NONE

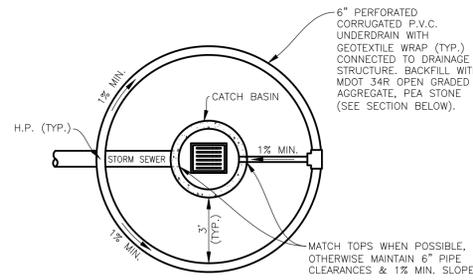

PLAN VIEW

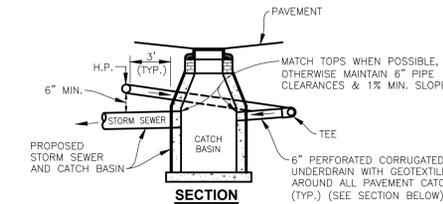


SECTION

TYPICAL 6" CIRCULAR UNDERDRAIN DETAIL

(WITHIN PARKING LOTS OUTSIDE CURB LINES)

DETAIL - 5B
SCALE: NONE

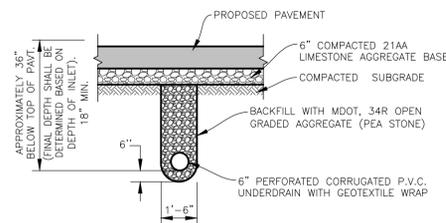


UNDERDRAIN DETAIL
DETAIL - 5C
SCALE: NONE

UNDERDRAIN NOTES

- UNDERDRAIN TO BE 6" PVC AASHTO M 252 SDR-35 WITH PERFORATIONS MEETING AASHTO M 278 OR M 252.
- ALL UNDERDRAIN SHALL BE INSTALLED AT A MIN. SLOPE OF 1%.
- PIPE SHALL BE INSTALLED WITH THE PERFORATIONS PLACED DOWN.
- PROPOSED UNDERDRAIN PIPE LAYOUT, FLOW LINE ELEVATION AND DETAILS SHALL BE APPROVED PRIOR TO CONSTRUCTION.


TYPICAL UNDERDRAIN DETAILS - 5

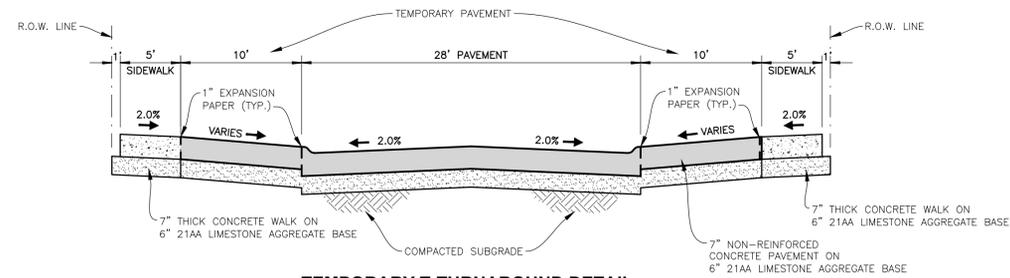

TEMPORARY T-TURNAROUND DETAIL
SCALE: NONE


TEMPORARY T-TURNAROUND NOTES

- PROVIDE TEMPORARY T-TURNAROUND PER FIGURE 2-02 OF THE MACOMB COUNTY SUBDIVISION DEVELOPMENT PROCEDURES, STANDARDS AND SPECIFICATIONS.
- CONSTRUCT TEMPORARY T-TURNAROUND CROSS SECTION PER THE DETAIL TO THE LEFT.
- PROVIDE THE STANDARD "ROAD ENDS" TREATMENTS PER FIGURE 4-13 OF THE MACOMB COUNTY SUBDIVISION DEVELOPMENT PROCEDURES, STANDARDS AND SPECIFICATIONS.

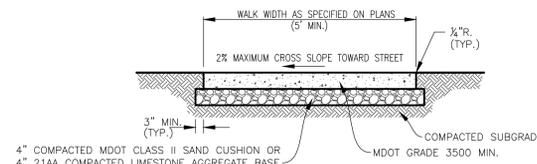


TYPICAL CROSS SECTION 4" CONCRETE SIDEWALK

DETAIL - 6A
SCALE: NONE

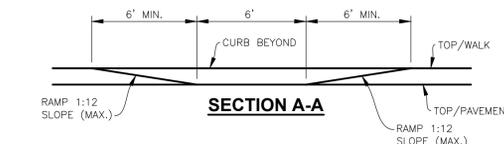


SECTION A-A

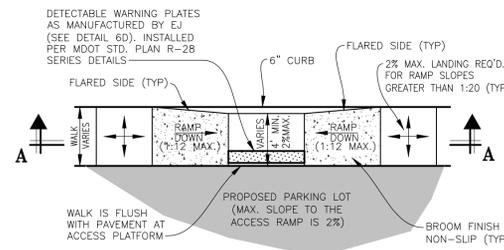

TYPICAL PARKING LOT SIDEWALK RAMP DETAIL

DETAIL - 6B
SCALE: NONE

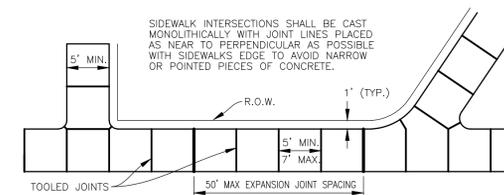


TYPICAL SIDEWALK JOINT LAYOUTS

DETAIL - 6C
SCALE: NONE

SIDEWALK JOINTS NOTES


- CONSTRUCT TRANSVERSE AND LONGITUDINAL EXPANSION AND PLANE OF WEAKNESS JOINTS AT INTERVALS AND LOCATIONS SHOWN ON THE PLANS. ALSO TRANSVERSE JOINTS WITH LIKE JOINTS IN ANY ADJACENT SLAB.
- CONSTRUCT JOINTS WITH FACES PERPENDICULAR TO THE SIDEWALK SURFACE.
- PLACE CONTRACTION JOINTS AT 5' MINIMUM AND 7' MAXIMUM INTERVALS. JOINTS ARE TO BE FULL WIDTH OF THE WALK AND MINIMUM 1/4 SLAB THICKNESS DEEP AND 1/8 INCH TO 1/4 INCH WIDE.
- PLACE 1" FIBER EXPANSION JOINT FILLERS AT MAX. 50' INTERVALS. EXTEND EXPANSION JOINT FILLER THE FULL DEPTH OF THE JOINT WITH THE TOP SLIGHTLY BELOW THE FINISHED SURFACE OF THE SIDEWALK.
- PLACE 1" FIBER EXPANSION JOINT FILLERS AT EACH SIDE OF DRIVE.
- PROVIDE 1" FIBER EXPANSION JOINT FILLERS AT CURB AND BUILDING OR R.O.W. LINE.

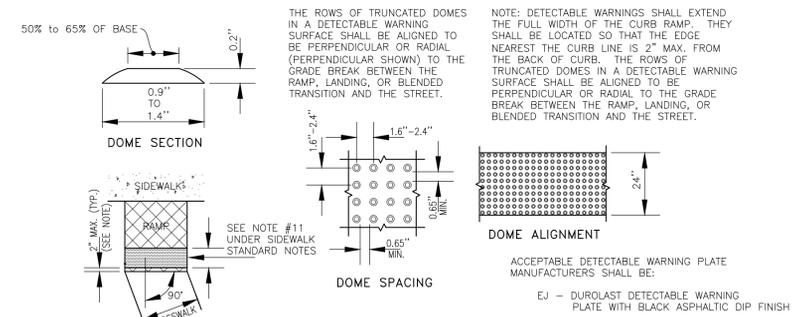

DETECTABLE WARNING DETAILS

M.D.O.T. STANDARD PLAN R-28 SERIES

DETAIL - 6D
SCALE: NONE

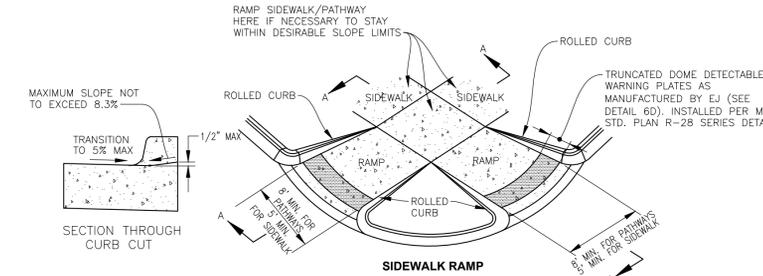

TYPICAL SIDEWALK RAMP DETAILS AT ROAD INTERSECTION

M.D.O.T. TYPE 4 STANDARD PLAN R-28 SERIES

DETAIL - 6E
SCALE: NONE

SIDEWALK STANDARD NOTES

- SIDEWALK RAMPS, CONFORMING TO PUBLIC ACT NO. 8, 1973, SHALL BE INSTALLED AS SHOWN ON THE PLAN AT ALL STREET INTERSECTIONS AND AT ALL BARRIER FREE PARKING AREAS AS INDICATED ON THE PLANS.
- SIDEWALK AND PATHWAY RAMPS ARE TO BE LOCATED AS SPECIFIED ON THE PLANS OR AS DIRECTED BY THE ENGINEER. DETAILS RC, RD, & RE SHOW SIDEWALK RAMP DETAILS AT PARKING LOT AND ROADWAY INTERSECTION. HANDICAP RAMPS SHALL MEET A.D.A. BARRIER FREE REQUIREMENTS.
- RAMPS SHALL BE PROVIDED AT CORNERS OF AN INTERSECTION WHERE THERE IS EXISTING OR PROPOSED SIDEWALK AND CURB.
- SURFACE TEXTURE OF THE RAMP SHALL BE THAT OBTAINED BY A COARSE BROOMING, TRANSVERSE TO THE SLOPE OF RAMP.
- SIDEWALK SHALL BE RAMPED WHERE THE DRIVEWAY CURB IS EXTENDED ACROSS THE WALK.
- CARE SHALL BE TAKEN TO ASSURE A UNIFORM GRADE ON THE RAMP, FREE OF SAGS AND SHORT GRADE CHANGES. WHERE CONDITIONS PERMIT, IT IS DESIRABLE THAT THE SLOPE OF THE RAMP BE IN ONLY ONE DIRECTION, PARALLEL TO THE DIRECTION OF TRAVEL.
- IF POSSIBLE, DRAINAGE STRUCTURES SHOULD NOT BE PLACED IN LINE WITH RAMPS, EXCEPT WHERE EXISTING DRAINAGE STRUCTURES ARE BEING UTILIZED IN THE NEW CONSTRUCTION LOCATION OF THE RAMP SHOULD TAKE PRECEDENCE OVER LOCATION OF DRAINAGE STRUCTURE.
- THE NORMAL GUTTER LINE PROFILE SHALL BE MAINTAINED THROUGH THE AREA OF THE RAMP.
- THE TOP OF THE JOINT FILLER FOR ALL RAMP TYPES SHALL BE FLUSH WITH THE ADJACENT CONCRETE.
- CROSSWALK AND STOP LINE MARKINGS, IF USED, SHALL BE SO LOCATED AS TO STOP TRAFFIC SHORT OF RAMP CROSSINGS. SPECIFIC DETAILS FOR MARKING APPLICATIONS ARE GIVEN IN THE "MICHIGAN MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES".
- DETECTABLE WARNING SHALL EXTEND THE FULL WIDTH OF THE CURB RAMP. THEY SHALL BE LOCATED AND INSTALLED AS INDICATED ON MDOT STANDARD PLAN R-28 SERIES DETAILS.

TYPICAL CONCRETE SIDEWALK DETAILS - 6



MACOMB TOWNSHIP
54111 BROUGHTON ROAD
MACOMB, MI 48042

586-992-0710



NOTE: UTILITY INFORMATION ON THIS DRAWING MAY BE FROM INFORMATION DISCLOSED TO THIS FIRM BY THE VARIOUS UTILITY COMPANIES, CITY/COUNTY AGENCIES AND OTHER VARIOUS SOURCES. UNDERGROUND UTILITIES WHICH ARE ON PRIVATE PROPERTY ARE USUALLY NOT DELINEATED UPON A UTILITY COMPANY'S PUBLISHED PLANS. THEIR LOCATION, IF SHOWN UPON THIS SURVEY, ARE APPROXIMATED FROM FOUND PAINT MARKS/STAKES, ETC. AS LOCATED BY THIS FIRM FROM SOURCES WHICH ARE UNKNOWN. NO GUARANTEE IS GIVEN AS TO THE COMPLETENESS OR ACCURACY THEREOF.

PRIOR TO CONSTRUCTION, ALL LOCATIONS AND DEPTHS OF EXISTING UTILITIES (IN CONFLICT WITH PROPOSED IMPROVEMENTS) SHALL BE VERIFIED IN THE FIELD. CALL MISS DIG 3 WORKING DAYS PRIOR TO CONSTRUCTION.

TOWNSHIP OF MACOMB

PAVING STANDARD DETAILS (2 OF 2)

TOWN 3 NORTH RANGE 13 EAST
MACOMB TOWNSHIP
MACOMB COUNTY

NO.	DATE	REVISION
1	10-15-14	SHEET UPDATE
2	11-06-15	SHEET UPDATE
3	01-04-16	SIDEWALK RAMP THICKNESS
4	01-24-17	SHEET UPDATE
5	08-20-18	SHEET UPDATE
6	09-26-19	TEMP. T-TURNAROUND
7	11-05-25	SHEET UPDATE

VERIFY SCALES

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET,
ADJUST SCALES ACCORDINGLY

JOB NO.	DRAWING NO.
	MA-DET-PAV
SCALE:	SHEET NO.
N.T.S.	P2